

# CICP2800PCHGBD

## Accelterm Charger Board

### Installation Instructions

WI2046 02/13

#### GENERAL INFORMATION

The required CICP2800PCHGBD Accelterm Charger Board is installed on the horizontal shelf of the Accelterm enclosure (see installation instructions WI1989 for more information regarding the installation of the Accelterm control panel).



CICP2800PCHGBD

#### SPECIFICATIONS

12VDC rated at 6.25A.


#### REMOVAL AND INSTALLATION



The CICP2800PCHGBD should be installed in accordance with The National Electrical Code, ANSI / NFPA 70 and all applicable Local Regulations.

1. **▲ Caution:** Before servicing the CICP2800PCHGBD Charger Board, turn off branch circuit and disconnect the battery wires to remove all power from the system. **Note:** This breaker may be in a building power distribution panel located within another secure area.
2. Disconnect the wiring harnesses from the CICP2800PCHGBD.
3. Unfasten the four (4) mounting nuts that secure the CICP2800PCHGBD to the metal power supply shelf.
4. Carefully remove the CICP2800PCHGBD from the enclosure.
5. Install the new CICP2800PCHGBD Charger Board in the reverse order of removal.

See installation instructions WI1989 for more information regarding the Accelterm control panel.

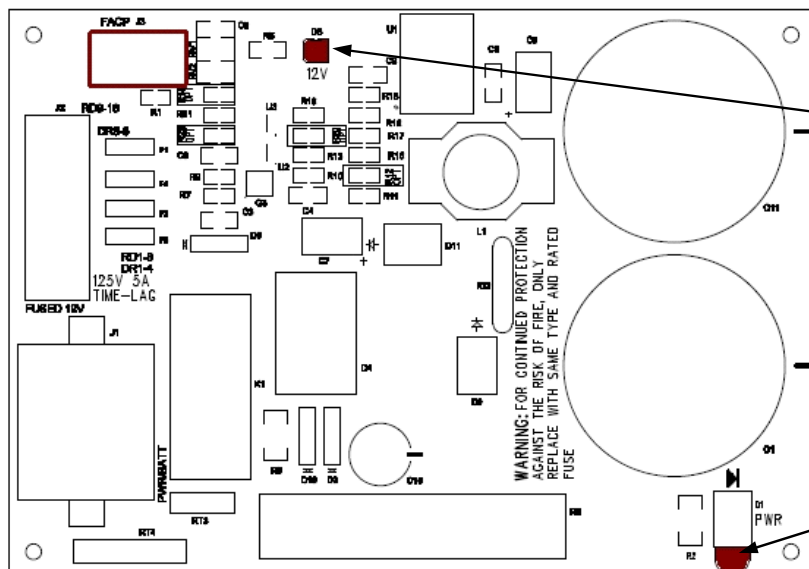

**12V**  
12 Volt DC Output from board, either from Power Supply or from Backup Battery

**PWR**  
12 Volt DC Into board from Power Supply. Does not light if operating on Backup Battery

CICP2800PCHGBD Accelterm Charger Board LED Locations